

# STRUCTURAL ENGINEERING


*Tom Keller*

Administrator


ACCEPTED	YES 2-25-09
ACCEPTED AS NOTED	
NOT ACCEPTED	

For general conformance with design plans and specifications only. Does not relieve contractor from responsibility for errors or omissions.


6" LONG #4 EPOXY COATED REBAR TO BE DRILLED AND EPOXIED INTO THE CURB WALL. DOWEL TO BE 2" ABOVE WALL FOR 4" CURB AND 3" ABOVE WALL FOR A 6" CURB

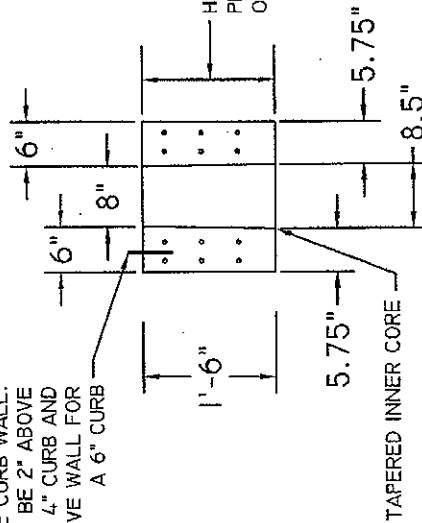


6 ROWS OF #4 EPOXY COATED REBAR 1-1/2" FROM THE INSIDE & OUTSIDE WALLS IN ALL FOUR SIDES



UTILITY ANCHOR CAST IN LOCATION TO BE DETERMINED BY LENGTH OF TRENCH TYP. 3 PLACES

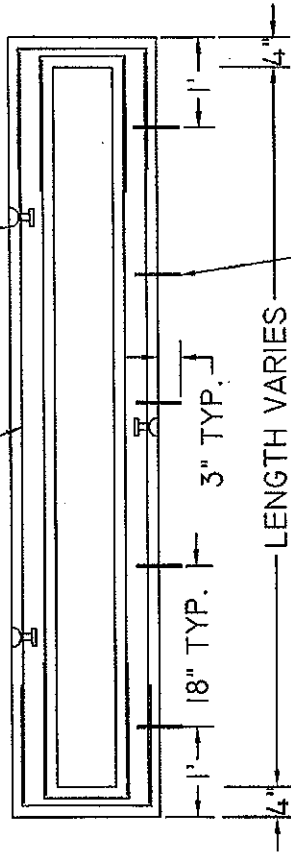

6" LONG #4 EPOXY COATED REBAR TO BE DRILLED AND EPOXIED INTO THE PAVEMENT SIDE WALL.

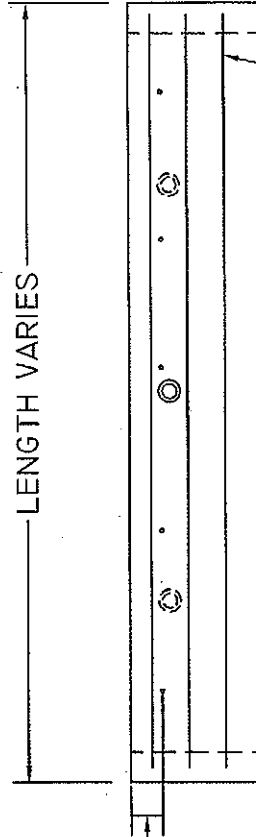

6 ROWS OF #4 EPOXY COATED REBAR 1-1/2" FROM THE INSIDE & OUTSIDE WALLS IN ALL FOUR SIDES

1/2 THICKNESS OF THE PAVEMENT

HEIGHT VARIES PENDING SLOPE OF GUTTER

AVAILABLE IN LENGTHS OF 4', 5', 8', 10', AND 12'

PRINT BY: CJM

PRINT #  
TYPE A EXT

HANSON PIPE & PRECAST

SIDNEY, OHIO

PHONE 937 492-9119 FAX 937 492-8634

# STRUCTURAL ENGINEERING

*Tom Keller*


Administrator

ACCEPTED	JRS 2-25-08
ACCEPTED AS NOTED	
NOT ACCEPTED	


For general conformance with design plans and specifications only. Does not relieve contractor from responsibility for errors or omissions.

6 ROWS OF #4 EPOXY COATED REBAR 1-1/2" FROM THE INSIDE & OUTSIDE WALLS IN ALL FOUR SIDES


UTILITY ANCHOR CAST IN LOCATION TO BE DETERMINED BY LENGTH OF TRENCH TYP. 3 PLACES

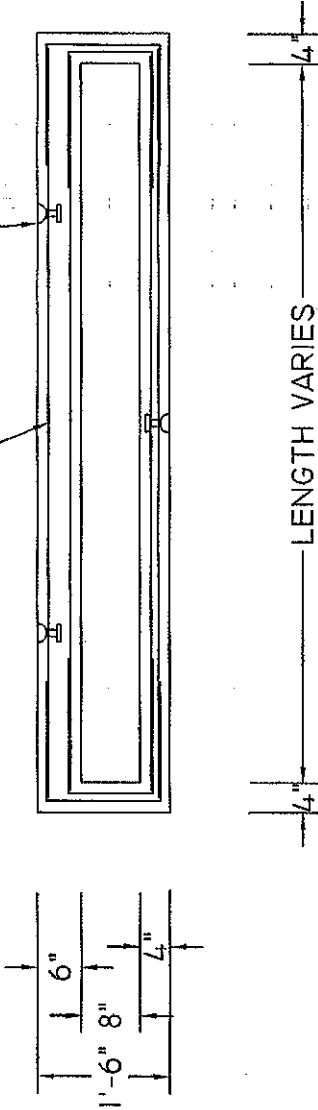

6" LONG #4 EPOXY COATED REBAR TO BE DRILLED AND EPOXIED INTO THE CURB WALL. DOWEL TO BE 3" ABOVE WALL

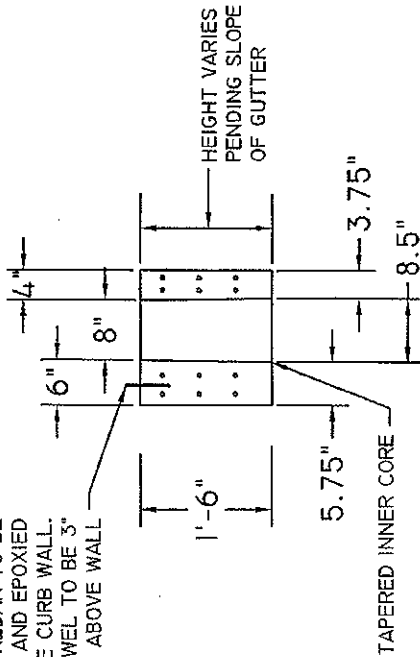

6 ROWS OF #4 EPOXY COATED REBAR 1-1/2" FROM THE INSIDE & OUTSIDE WALLS IN ALL FOUR SIDES

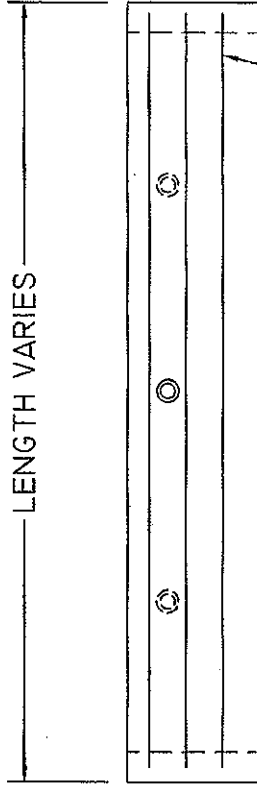

AVAILABLE IN LENGTHS OF 4', 5', 8', 10', AND 12'

HANSON PIPE & PRECAST

PRINT BY: CJM

PRINT #

SIDNEY, OHIO

TYPE B EXT

PHONE 937 492-9119 FAX 937 492-8434

# STRUCTURAL ENGINEERING


*Tim Keller*

Administrator

ACCEPTED	85 2-25-08
ACCEPTED AS NOTED	
NOT ACCEPTED	




For general conformance with design plans and specifications only. Does not relieve contractor from responsibility for errors or omissions.

6" LONG #4 EPOXY COATED REBAR TO BE DRILLED AND EPOXIED INTO THE CURB WALL. DOWEL TO BE 2" ABOVE WALL FOR 4" CURB AND 3" ABOVE WALL FOR A 6" CURB

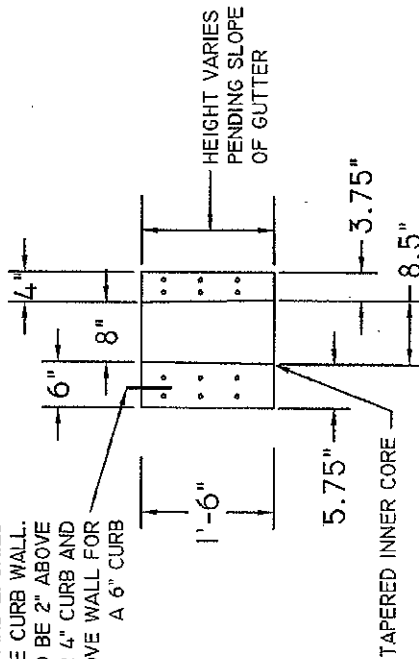

6 ROWS OF #4 EPOXY COATED REBAR 1-1/2" FROM THE INSIDE & OUTSIDE WALLS IN ALL FOUR SIDES

UTILITY ANCHOR CAST IN LOCATION TO BE DETERMINED BY LENGTH OF TRENCH TYP. 3 PLACES

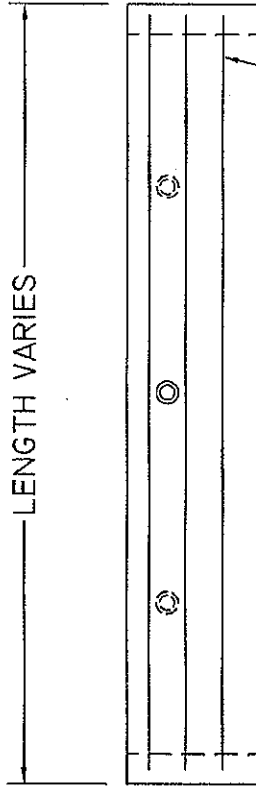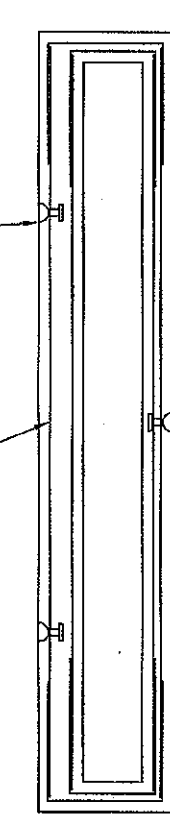

6 ROWS OF #4 EPOXY COATED REBAR 1-1/2" FROM THE INSIDE & OUTSIDE WALLS IN ALL FOUR SIDES

AVAILABLE IN LENGTHS OF 4', 5', 8', 10', AND 12'

HANSON PIPE & PRECAST	PRINT BY: CJM	PRINT #	TYPE C EXT
		SIDNEY, OHIO	
			PHONE 937 492-9119 FAX 937 492-8634