


CROSS-SECTION OF PAVEMENT

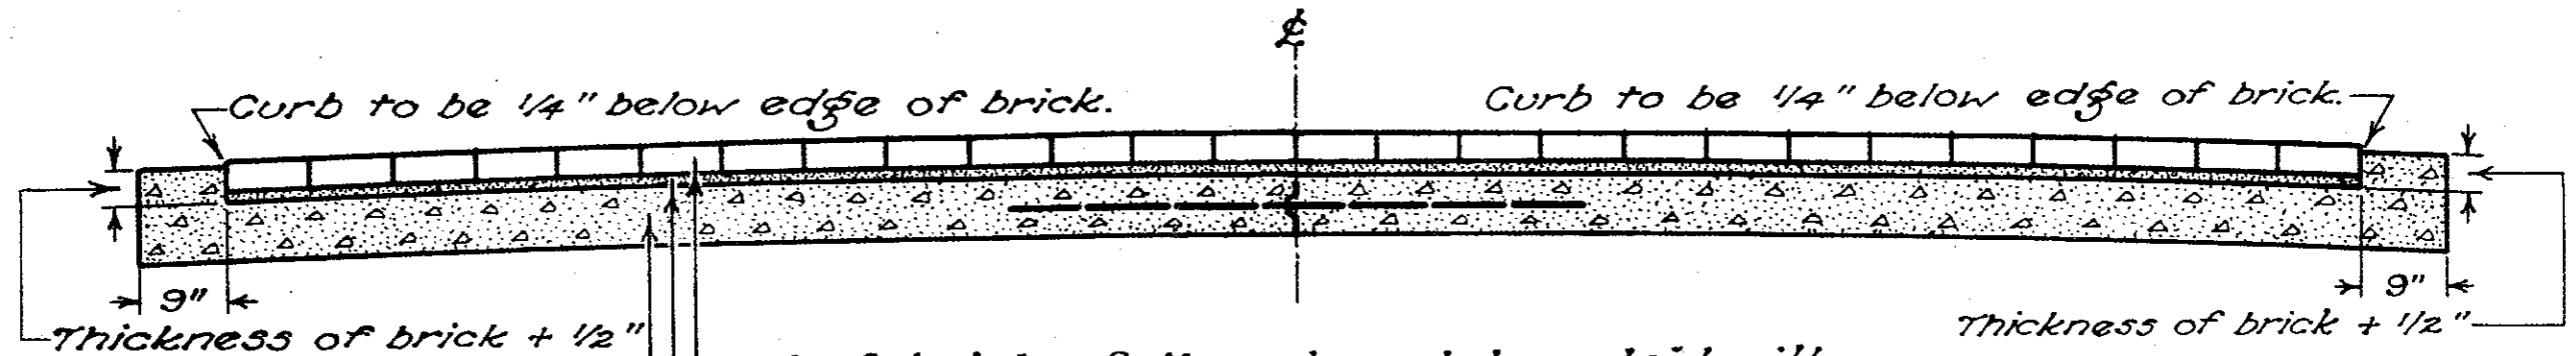

—Lug brick of the wirecut type, laid with a depth of 2 1/2, 3, 3 1/2 or 4 inches with the best wirecut side exposed.

—3/4" Cushion.

—Not less than 6" for non-reinforced concrete depending on traffic and soil conditions. With Transverse Contraction Joints, spaced 50 feet, and impressed or steel Center Joint with dowels. (No edge bars to be used).

BRICK PAVEMENT:—Item T-9, General Specifications.

BRICK:—Item M-4, Material Details.

CUSHION:—Sand, Item M-2.4 or slag, Item M-3.12, Material Details.

FILLER:—F-1, Item M-5.4, Material Details. Unless otherwise specified.

CONCRETE:—Non-reinforced, Item B-5. Reinforced specified as per plan.

TRANSVERSE CONTRACTION JOINT:—Construction Drawing No. 95.

CENTER JOINT:—Impressed Joint, Construction Drawing No. 98 or Steel Joint, Construction Drawing No. 100.

CROWN DETAIL:—Construction Drawing No. 144.

SHOULDERS, SLOPES AND DITCHES:—Construction Drawing No. 143.

BUREAU OF CONSTRUCTION
OHIO
DEPARTMENT OF HIGHWAYS

REVISED

**BRICK
ON CONCRETE BASE
UNIFORM THICKNESS BASE**

STANDARD
CONSTRUCTION DRAWING **130**
DEC. 5, 1932

APPROVED *E. H.* CHIEF ENGR. CONST.